Data Centers

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

GreenGov

October 2010 | Washington, D.C.

Will Lintner

Federal Energy Management Program

The Case for Change

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- The number of Federal data centers and server closets has tripled from approximately 400 in 1998 to over 1100 today.
- Major agencies' IT spending increased from about $45 billion in 2001 to nearly $75 billion today.
- Data center energy use doubled from 2000 to 2006. The EPA predicted that under current trends, data center energy use would almost double again between 2006 to 2011.
- Data centers could account for approximately 10 to 15 % of Federal facility energy use.

Data Center Energy Performance

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Typical Data Center Energy End Use

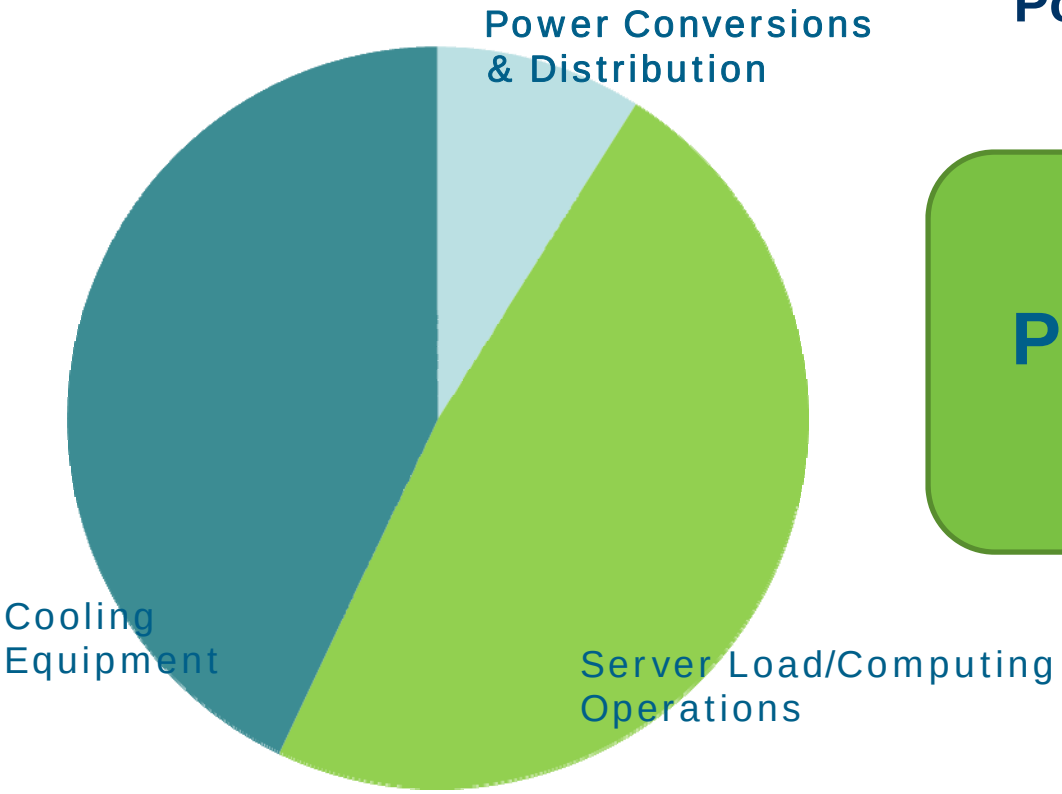

Power Usage Effectiveness (PUE)

$$PUE = \frac{\text{Total Data Center Power}}{\text{IT Power}}$$

Executive Order 13514

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Federal Leadership in Environmental, Energy & Economic Performance directs Federal agencies to:

(i) Promote electronics stewardship, in particular by:

- **(i) Ensuring procurement preferences for EPEAT-registered electronic products;**
- **(ii) Establishing and implementing policies to enable power management, duplex printing and other energy-efficient of environmentally preferable features on all eligible agency electronic products;**
- **(iii) Employing environmentally sound practices with respect to the agency's disposition of all agency excess o r surplus electronic products;**
- **(iv) Ensuring the procurement of EnergyStar and FEMP-designated electronic equipment**
- **(v) Implementing best management practices for energy-efficient management of servers and Federal data centers**

FEMP Mission

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

FEMP Federal Energy Management Program

FEMP Facilitates the Federal Government's implementation of sound, cost-effective energy management & investment practices to enhance the nation's energy security & environmental stewardship

FEMP is Here to Help You Achieve Results!

Get up to speed with guides & resource publications

***Become engaged** with training & awareness workshops*

***Benchmark** sites using DCPro*

***Conduct assessments** to determine appropriate efficiency measures*

***Implement** energy efficiency projects!*

- ***Save Money***
- ***Reduce Loads***
- ***Save Energy***
- ***Reduce Emissions***

Recent Data Center Resources

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- Best Practices Guide
- Benchmarking Guide
- Data Center Programming Guide
- Technology Case Study Bulletins

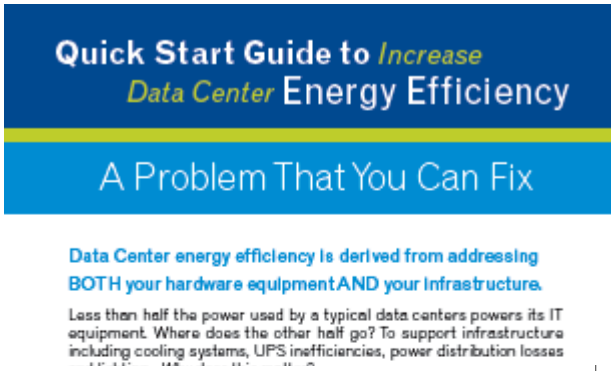

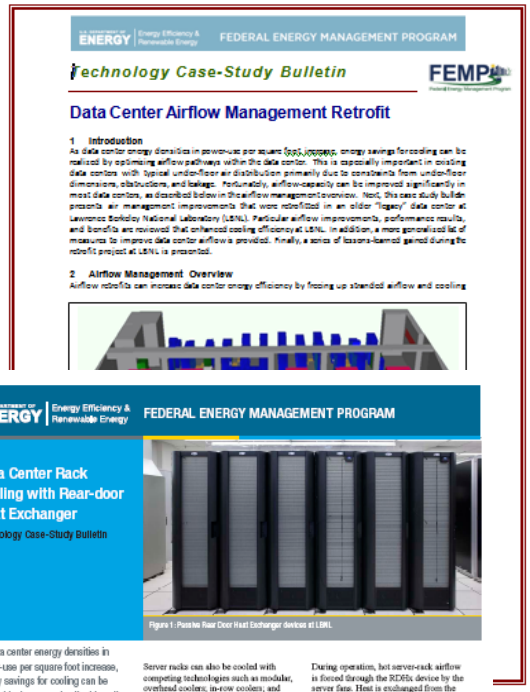

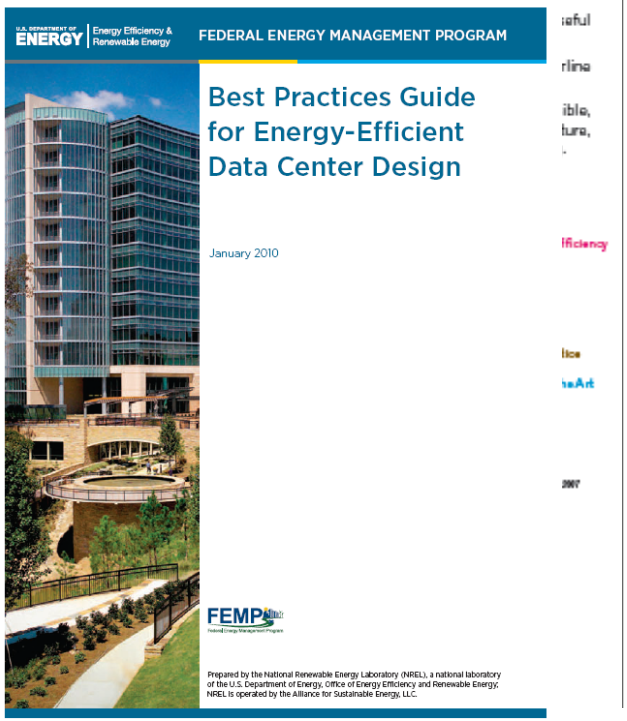

Training

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

DOE/ASHRAE Awareness Training

- *One-day training*
- *Target audience: data center operators*
- *No prequalifications*

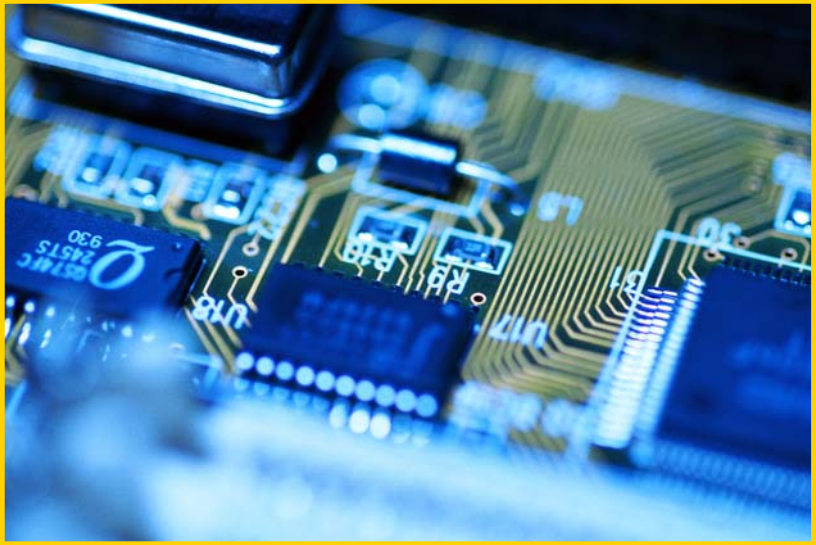

Data Center Energy Practitioner (DCEP) Program - Generalist

- Three-day workshop with two options:
  - Training certificate (not yet available)
  - Training & exam (In pilot stage)
- Target audience: DC personnel, consultants, & service providers.
- Next: **San Francisco, November 15-18**

DCEP - SPECIALIST

- Pre-qualifications: *Pass Generalist exam*
- Practitioner tracks:
  - HVAC
  - Electrical & IT coming soon

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Data Center Profiling Suite (DC-PRO)

- Designed for data center owners &operators
- Diagnoses how energy is used within a data centers
- Determines ways to save energy and money.
- Contains additional components for more detailed air management & electrical assessments - IT & HVAC components coming soon

Inputs
- Utility bill data
- Systems information
- Facility description

Outputs
- End-use break out
- Energy reduction potential
- Areas for improvement

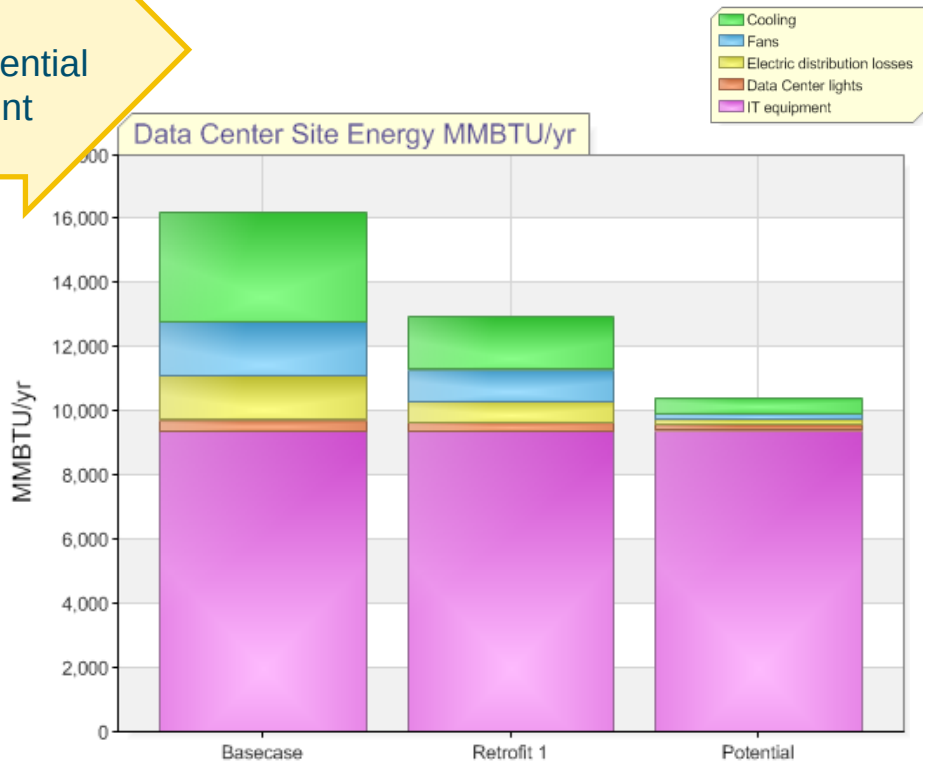

Metrics & Benchmarking

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Power Usage Effectiveness

$$PUE = \frac{Total\ Facility\ Power}{IT\ Equipment\ Power}$$

Standard	Good	Better
2.0	1.4	1.1

Heating, Ventilation & Air-Conditioning System Effectiveness

$$\text{Effectiveness} = \frac{kWh/yr_{\ IT}}{kWh/yr_{\ HAVAC}}$$

Standard	Good	Better
0.7	1.4	2.5

Airflow Efficiency

$$\frac{\text{Total Fan Power (W)}}{\text{Total Fan Airflow (cfm)}}$$

Standard	Good	Better
1.25W/cfm	0.75 W/cfm	0.5 kW/cfm

Cooling System Efficiency

$$\frac{\text{Average Cooling System Power (kW)}}{\text{Average Cooling Load (ton)}}$$

Standard	Good	Better
1.1 kW/ton	0.8 kW/ton	0.6 kW/ton

Collaboration

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

FEDERAL PARTNERSHIP FOR GREEN DATA CENTERS

- The Federal Partnership for Green Data Centers was created in 2009 to advance the energy efficiency and renewable energy use goals of the Energy Independence and Security Act of 2007 (EISA 2007) as they relate to data centers.
- The group meets these goals by
  - Facilitating communication between member agencies.
  - Disseminating best practices for data center energy efficiency
  - Working with private sector to share information on new technologies with the Federal Government

http://www1.eere.energy.gov/femp/program/fpgdc.html

ENERGY EFFICIENT HIGH PERFORMANCE COMPUTING WORKING GROUP (EE HPC WG)

- The Energy Efficient HPC Working Group (EE HPC WG) will target both public and private HPC owners, operators and users to increase collective knowledge and stimulate demand for energy efficient HPC.
- Three sub-groups
  - Infrastructure
  - Computing systems
  - Conferences

http://eehpcwg.lbl.gov/home

Technical Assistance

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Selective Technical Assistance

- Training
- Technology demonstration
- Assessments
- Design reviews
- Metering plans

FEMP offers data center assistance to….

DOE

DIA

DOD

…and more!

NREL
Research Support Facility

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

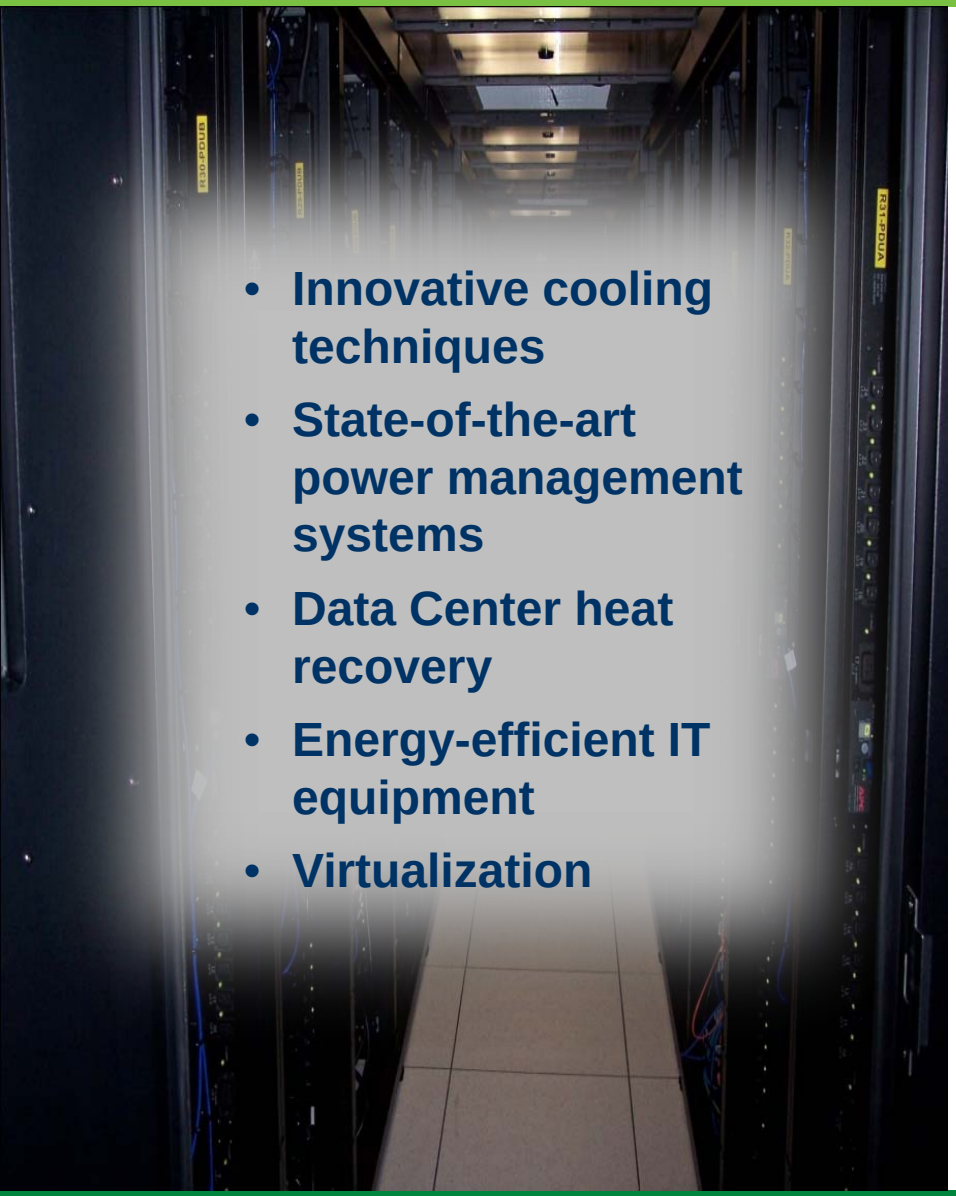

- Innovative cooling techniques
- State-of-the-art power management systems
- Data Center heat recovery
- Energy-efficient IT equipment
- Virtualization

Power Usage Effectiveness

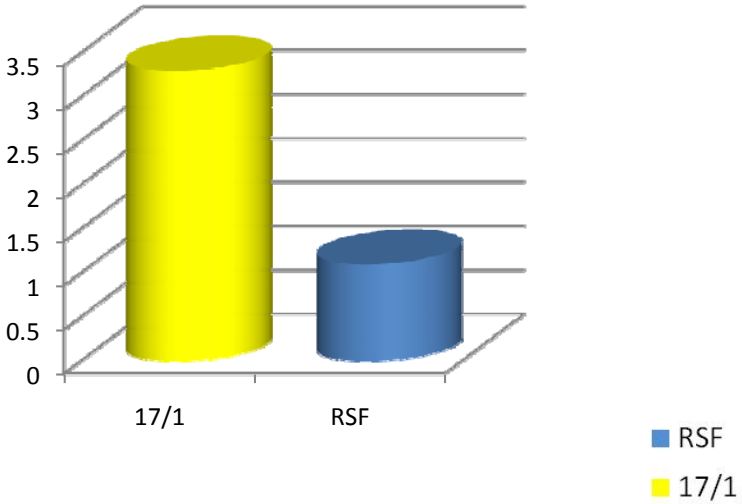

Data Center Power Usage

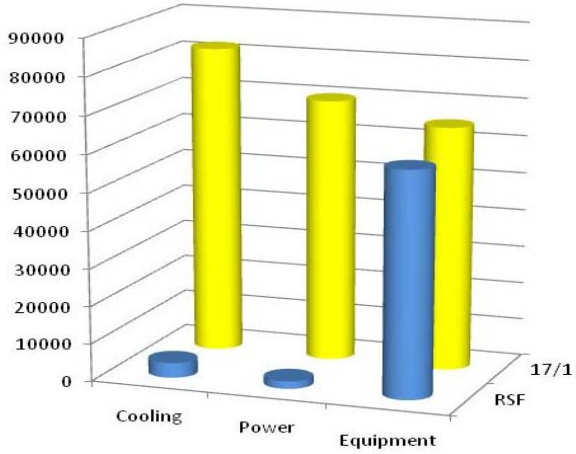

Argonne Leadership Computing Facility

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Argonne NATIONAL LABORATORY

Sample Recommendations

- Disable dehumidification
- Seal floor leaks
- Add integrated waterside economizer to CHW plant
- Install occupancy sensors to control lights
- Optimize cooling plant controls

Argonne	Current	After ECMs
Total Electrical Demand	1,866 kW	1,718 kW
PUE	1.46	1.34
Annual CO2 Emissions	15,200 tons	13,980 tons

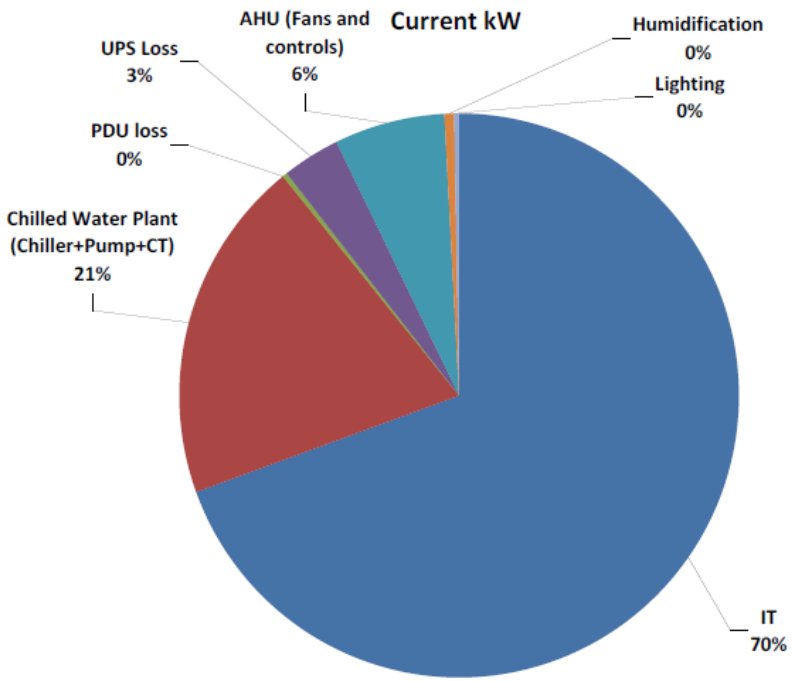

Implementing suggested changes would decrease facility power from 1,866 kW to 1,718 kW, curbing emissions by 1,220 tons of CO_2 per year.

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Data Center Assessments

Proposed ECMs:
- Full cooling system retrofit
- Installation of supply ducts in electrical room
- Retrofit lighting

Total Cost of $252,499

# 1	Current	After ECMs
Total Electrical Demand	775 kW	718 kW
PUE	1.65	1.53
Annual CO2 Emissions	5,771 tons	5,346 tons

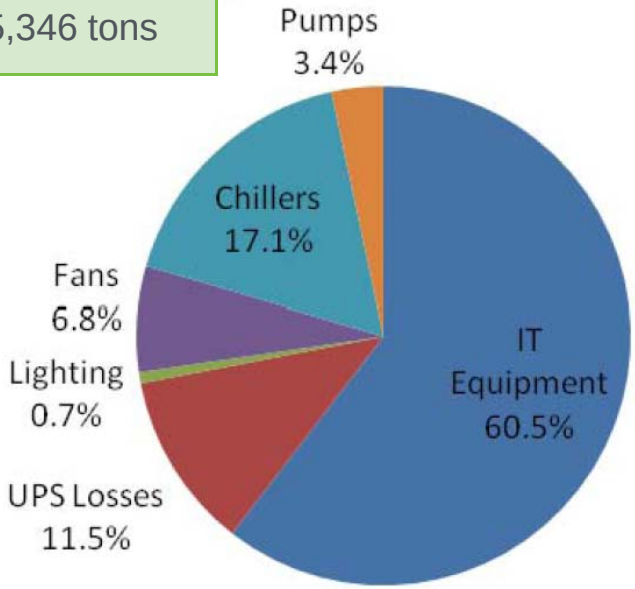

Implementing suggested changes would save $160,020 and decrease emissions by 425 tons of CO_2 per year.

Other Resources

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

FEMP Federal Energy Management Program **http://www1.eere.energy.gov/femp/program/data_center.html**

Save ENERGY Now ® **http://www1.eere.energy.gov/industry/datacenters/**

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

For help with your data center, please contact your FEMP Customer Service Representative:

http://www1.eere.energy.gov/femp/about/contacts.html

Contact Information

Will Lintner

Data Center Initiative Coordinator

Federal Energy Management Program

Energy Efficiency and Renewable Energy

Department of Energy

Tel: 202.586.3120

william.lintner@ee.doe.gov

Supplemental Slides:

Best Practices

AIR SUPPLY BEST PRACTICES

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

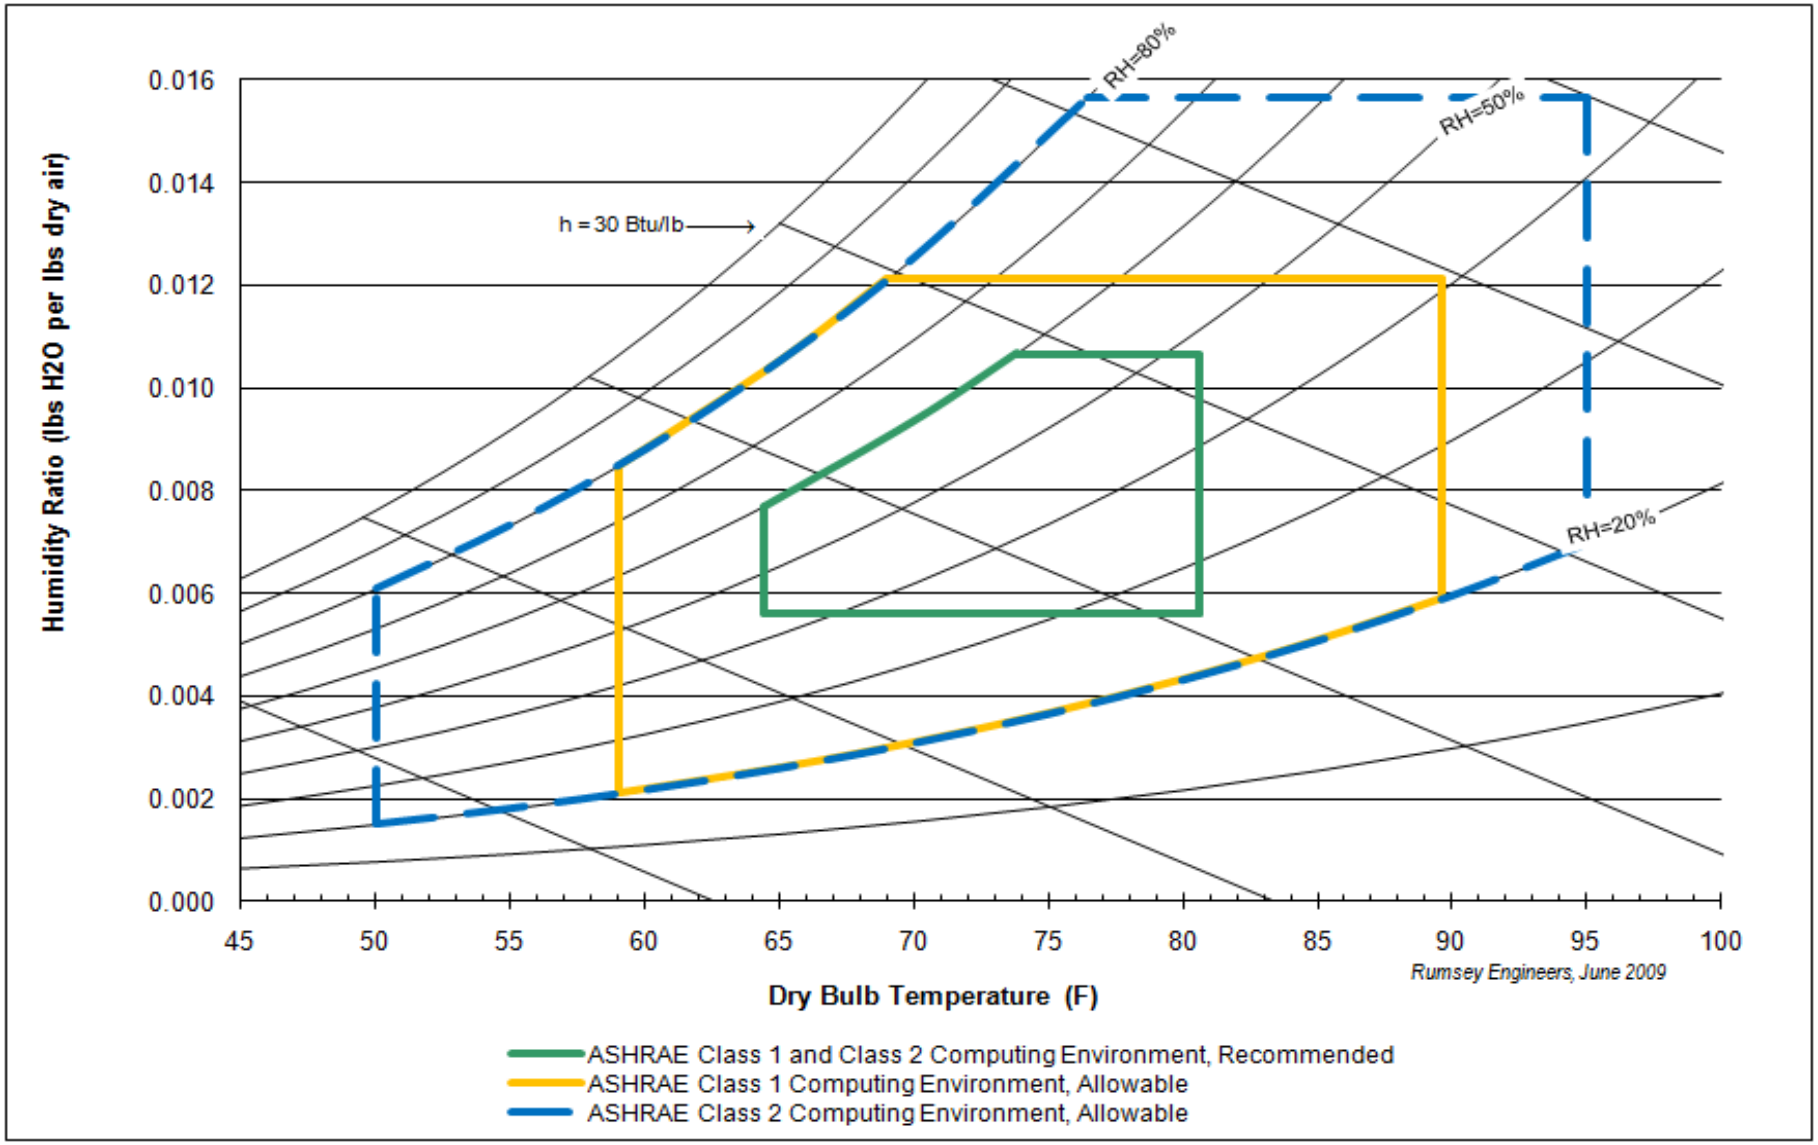

Air Management Best Practices

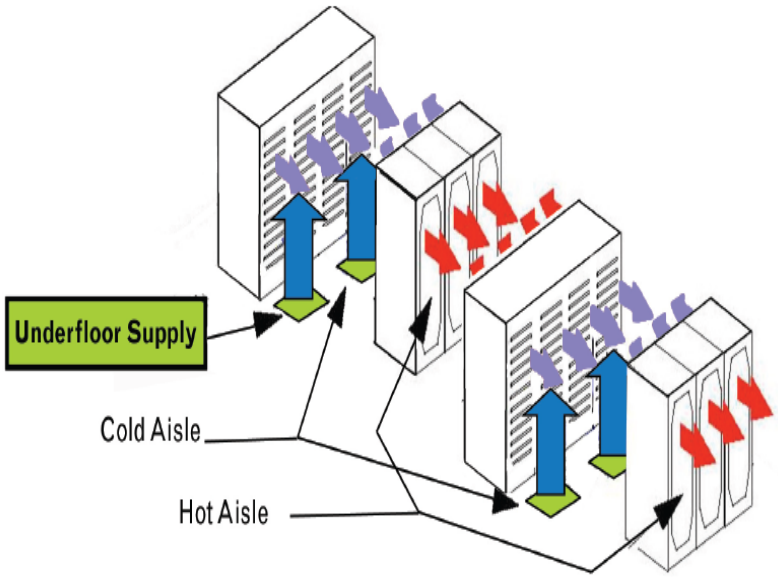

Hot aisle / cold aisle isolation decreases mixing of intake and exhaust air, promoting efficiency.

- Ensure cables are well managed
- Use a minimum clear height of 24 inches under raised floor installations.

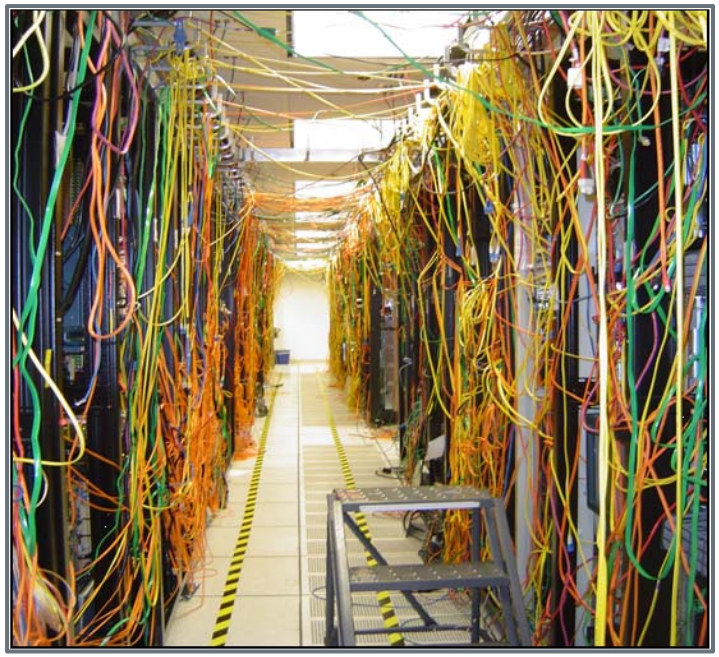

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Direct Liquid Cooling

- Transferring waste heat to a liquid at or near the server, rather than exhausting it into the room.

Free Cooling

- In mild climates, outside air can be used to cooled with an airside economizer
- Evaluate humidity and contamination concerns

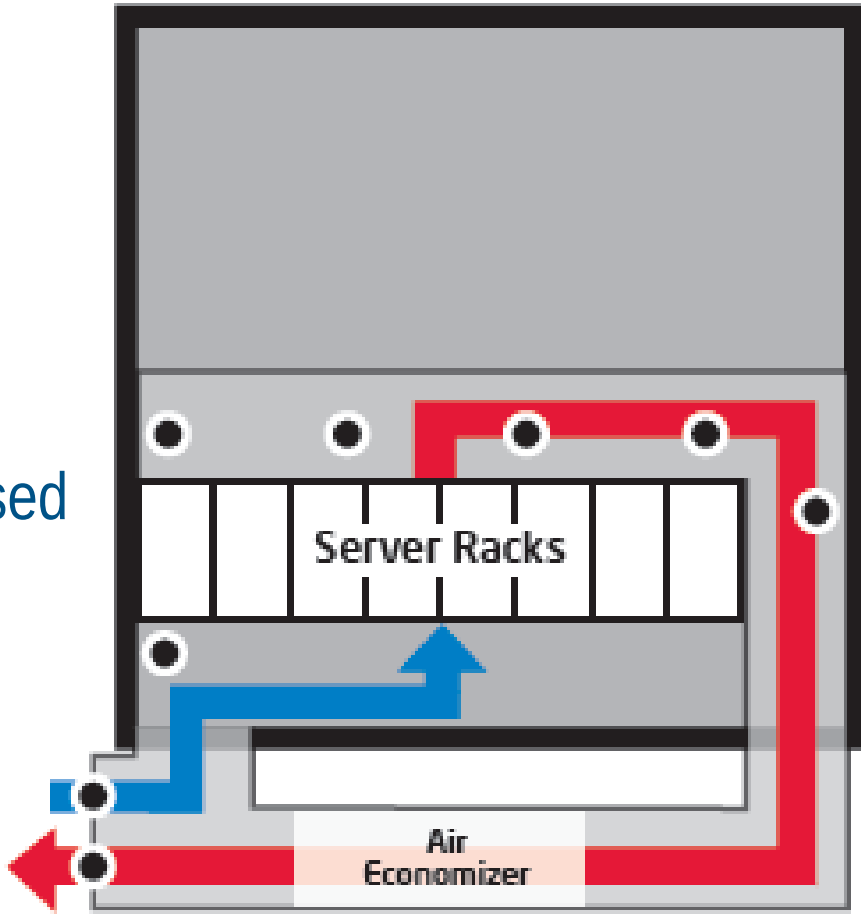

Air Economizer

Electrical Systems Best Practices

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

UPS

- Critical loads only on UPS

Redundancies

- Eliminate redundancies wherever possible

Lighting

- Install occupancy sensors
- Install lights in aisles, not over racks

Other Best Practices

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

On Site Generation

- On site generation can expand options for data center location
- Renewable energy possibilities – on site renewable energy
- Combined Heat & Power (CHP) – generates energy & useful heat at once

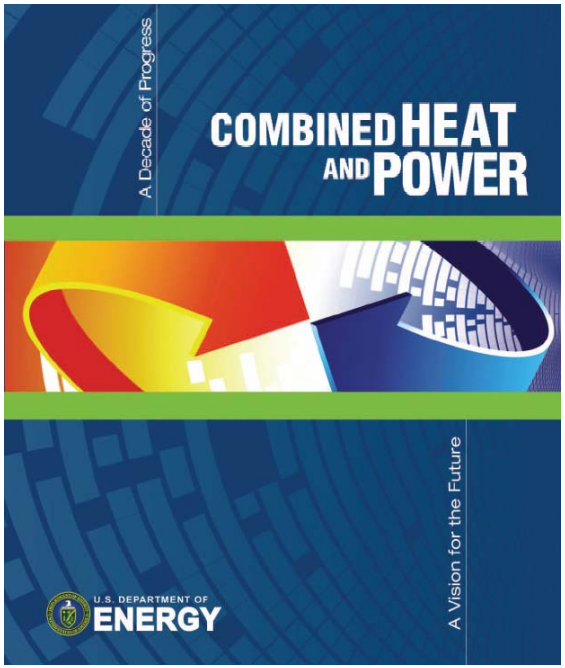

Energy Reuse

- Waste heat from data centers can most effectively be used for low temperature heating applications such as preheating ventilation

IT Systems Best Practices

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Servers

- Choose *variable speed fans*
- Enable *power management capabilities*!
- EnergyStar Servers

Power Supplies

- Optimal load level: 40-60%
- 80 PLUS Program offers certification of efficient power supplies

Storage Devices

- Take superfluous data offline
- Use thin provisioning technology

Consolidation

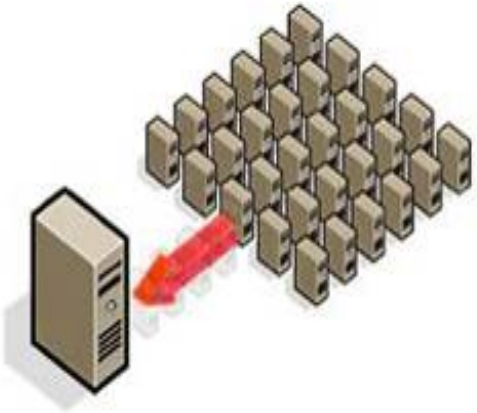

- Group hardware with similar heat load densities
- Practice virtualization